


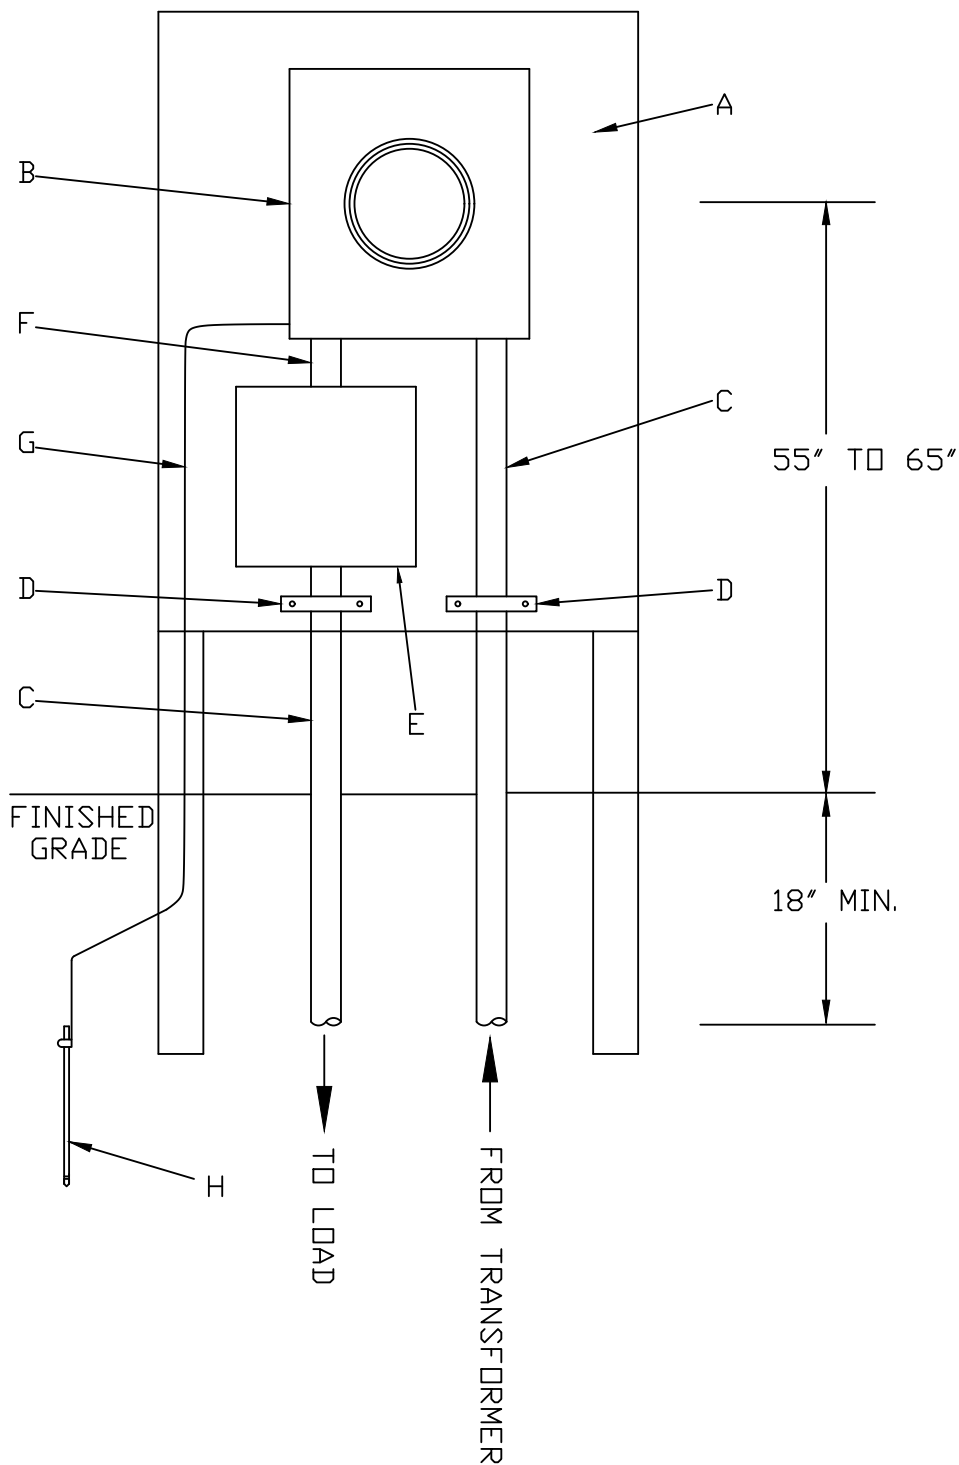

* NEW METER BASES MUST BE RINGLESS AND IN NEW CONDITION.

* ALL MATERIAL SUPPLIED AND ASSEMBLED BY MEMBER UNLESS NOTED.

CONDUCTOR & CONDUIT SIZES FOR THREE CONDUCTORS IN PIPE

LOOP CAPACITY	CONDUCTOR SIZE	CONDUIT DIAMETER
100 AMP	#3 Copper	1 1/4"
100 AMP	#2 Copper or Aluminum	1 1/4"
100 AMP	#1 Aluminum	1 1/2"
100 AMP	1/0 Aluminum	1 1/2"
200 AMP	2/0 Copper	2"
200 AMP	4/0 Aluminum	2"
300 AMP	350 Aluminum	3"
400 AMP	500 Copper or Aluminum	3"

ITEM	QTY.	MATERIAL
A	1	PEDESTAL - MUST BE MOUNTED ON ANGLE IRON, UNISTRUT, OR "APPROVED METAL EQUIVALENT", STURDY AND FIRMLY SET
B	1	METER SOCKET
C	AS REQD	CONDUIT, DIAMETER AND LENGTH AS REQUIRED SEE TABLE
D	2 MIN.	PIPE STRAPS
E	1	RAIN TIGHT MAIN DISCONNECT.
F	1	NIPPLE WITH LOCKNUTS, SIZE AS REQUIRED.
G	AS REQD	#6 Cu GROUND WIRE
H	1	GROUND ROD 5/8" X 8' AND CONNECTOR

METER ON PEDESTAL UNDERGROUND SOURCE

OZARKS ELECTRIC COOPERATIVE CORP.

DRAWN BY: RJE 12-05-96

REVISED BY: SK 04-07-2025

APPROVED BY: AM 04-07-2025

UM5-3