


ALL CIRCUITS SHALL HAVE GFI PROTECTION

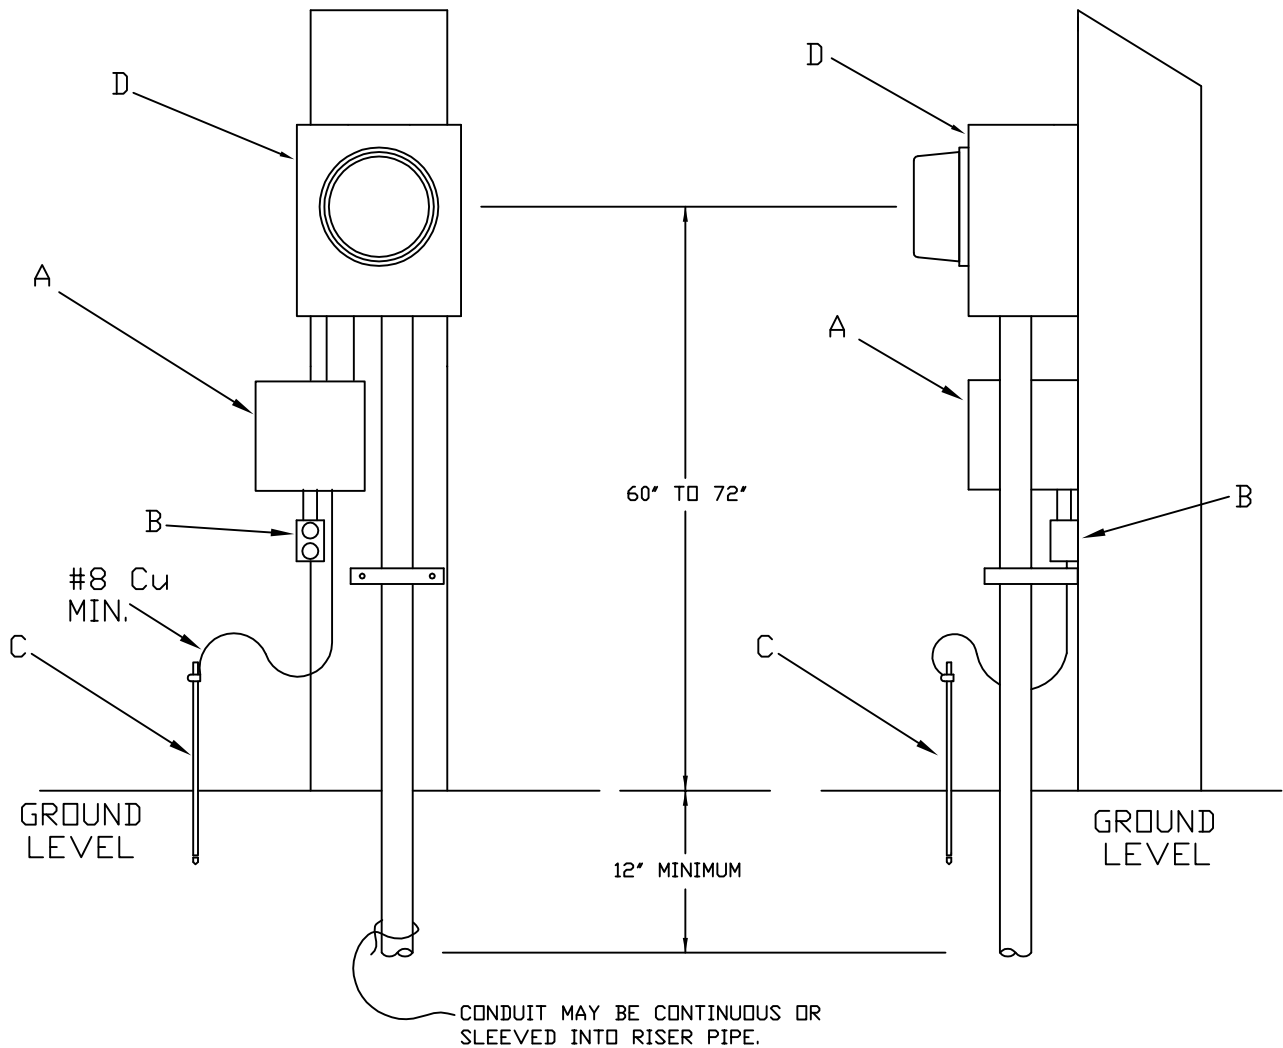

NOTES:

TEMPORARY SERVICE MUST PASS INSPECTION OF LOCAL GOVERNING AUTHORITY BEFORE METER IS SET.

ALL CIRCUITS ARE TO HAVE GFI PROTECTION.

ALL MATERIAL SUPPLIED AND ASSEMBLED BY MEMBER.

MEMBER TO PROVIDE CONDUCTOR AND TRENCH FROM LOAD TO SOURCE OF POWER.

CONDUCTOR WILL BE CONTAINED IN CONDUIT WITH A MINIMUM DEPTH OF 12" BELOW FINISHED GRADE.

NO TEMPORARY LOOPS SHALL BE SET ON TREES OR D.E.C.C. POLES.

TEMPORARY LOOPS SHALL BE SET AWAY FROM ALL VEHICULAR TRAFFIC.

ITEM	MATERIAL		
A	RAIN TIGHT DISCONNECT ALL CIRCUITS SHALL HAVE GFI PROTECTION	TYPICAL TEMPORARY SAW SERVICE UNDERGROUND SOURCE OZARKS ELECTRIC COOPERATIVE CORP. APPROVED BY: CWV DRAWN BY: RJE 11-22-96	
B	ALL CONVENIENCE OUTLETS SHALL BE EXTERIOR TYPE, RAIN TIGHT, SOLIDLY FASTENED DOWN, WITH NO EXPOSED CONDUCTOR.		
C	DRIVEN GROUND ROD, WIRE, AND CONNECTORS TO BE INSTALLED BY MEMBER OR MEMBER'S ELECTRICIAN. MINIMUM BURY FOR GROUND ROD IS 7 FEET.		
D	METER SOCKET PROVIDED BY MEMBER.		
		TEMP-B	