


# *CLEARANCE REQUIREMENTS FOR WORKING SPACE AROUND PAD MOUNTED TRANSFORMER*

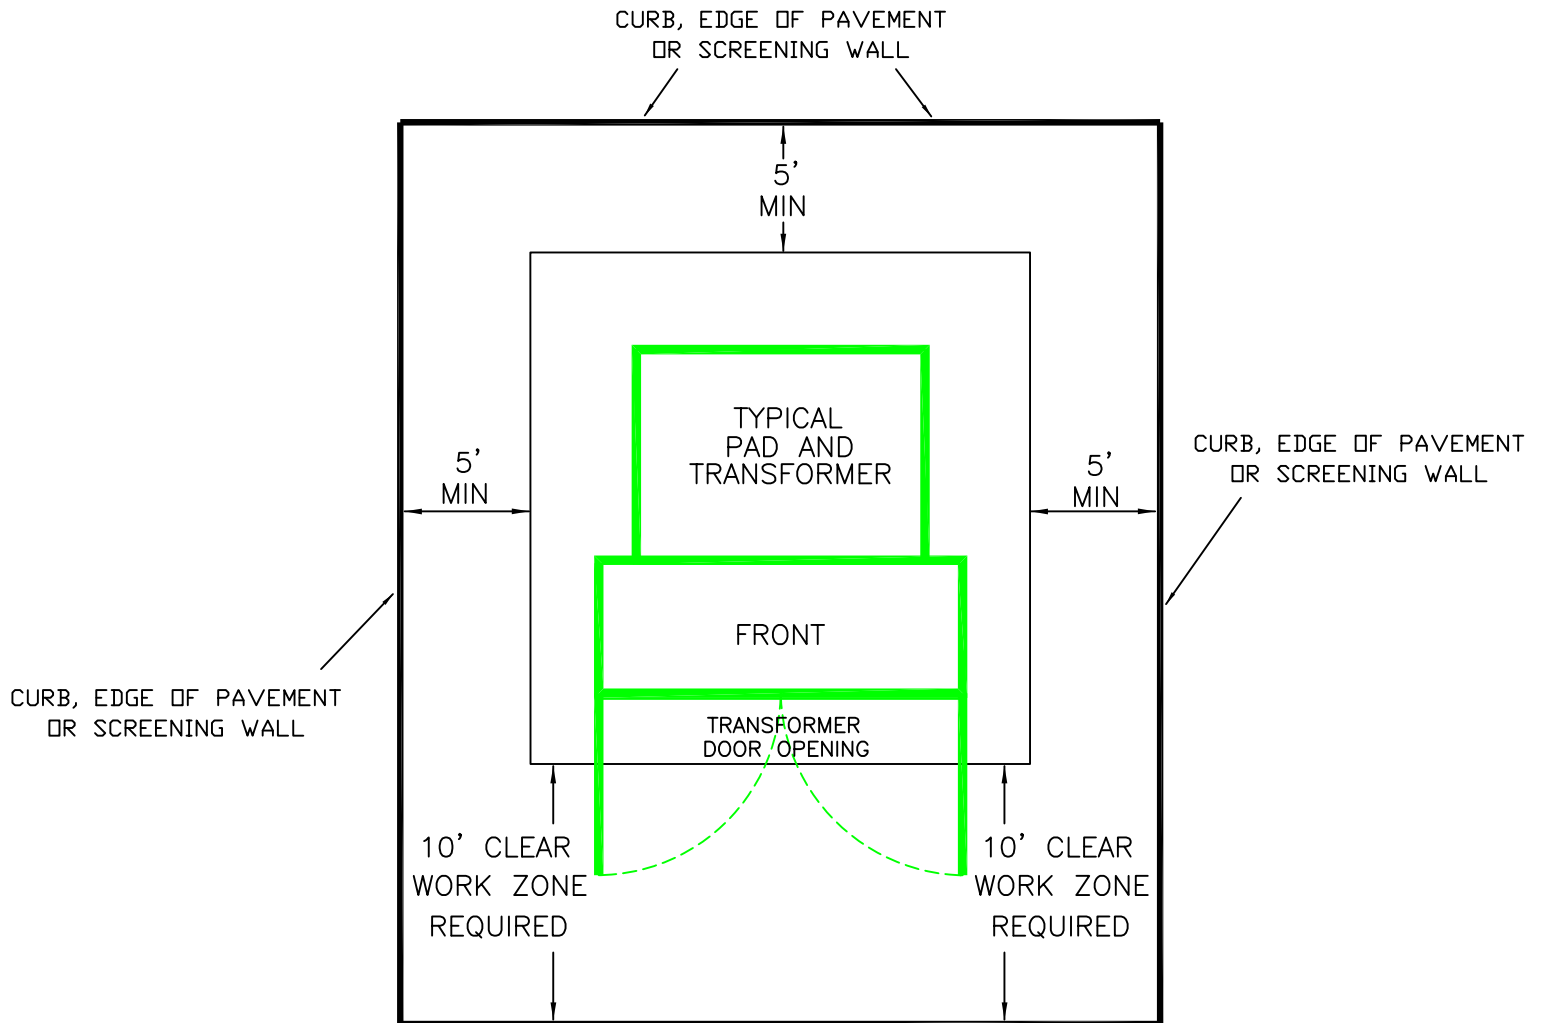

## *ADDITIONAL CLEARANCE REQUIREMENTS*

THE MINIMUM SEPERATION OF A TRANSFORMER FROM  
A BUILDING WITHOUT A FIREWALL IS:

75 KVA OR LESS = 10FT

76 TO 333 KVA = 20FT

334 KVA AND LARGER = 30FT

**OZARKS ELECTRIC COOPERATIVE CORP**

ARKANSAS-24-WASHINGTON

FAYETTEVILLE, ARKANSAS

DRAWN BY: L4K

APPROVED BY: GM

REVISED BY: L4K

APPROVED BY: GM

DATE: 2-18-11

DATE: 2-18-11

DATE: 7-1-14

DATE: 7-1-14