


ALL CIRCUITS SHALL HAVE GFI PROTECTION

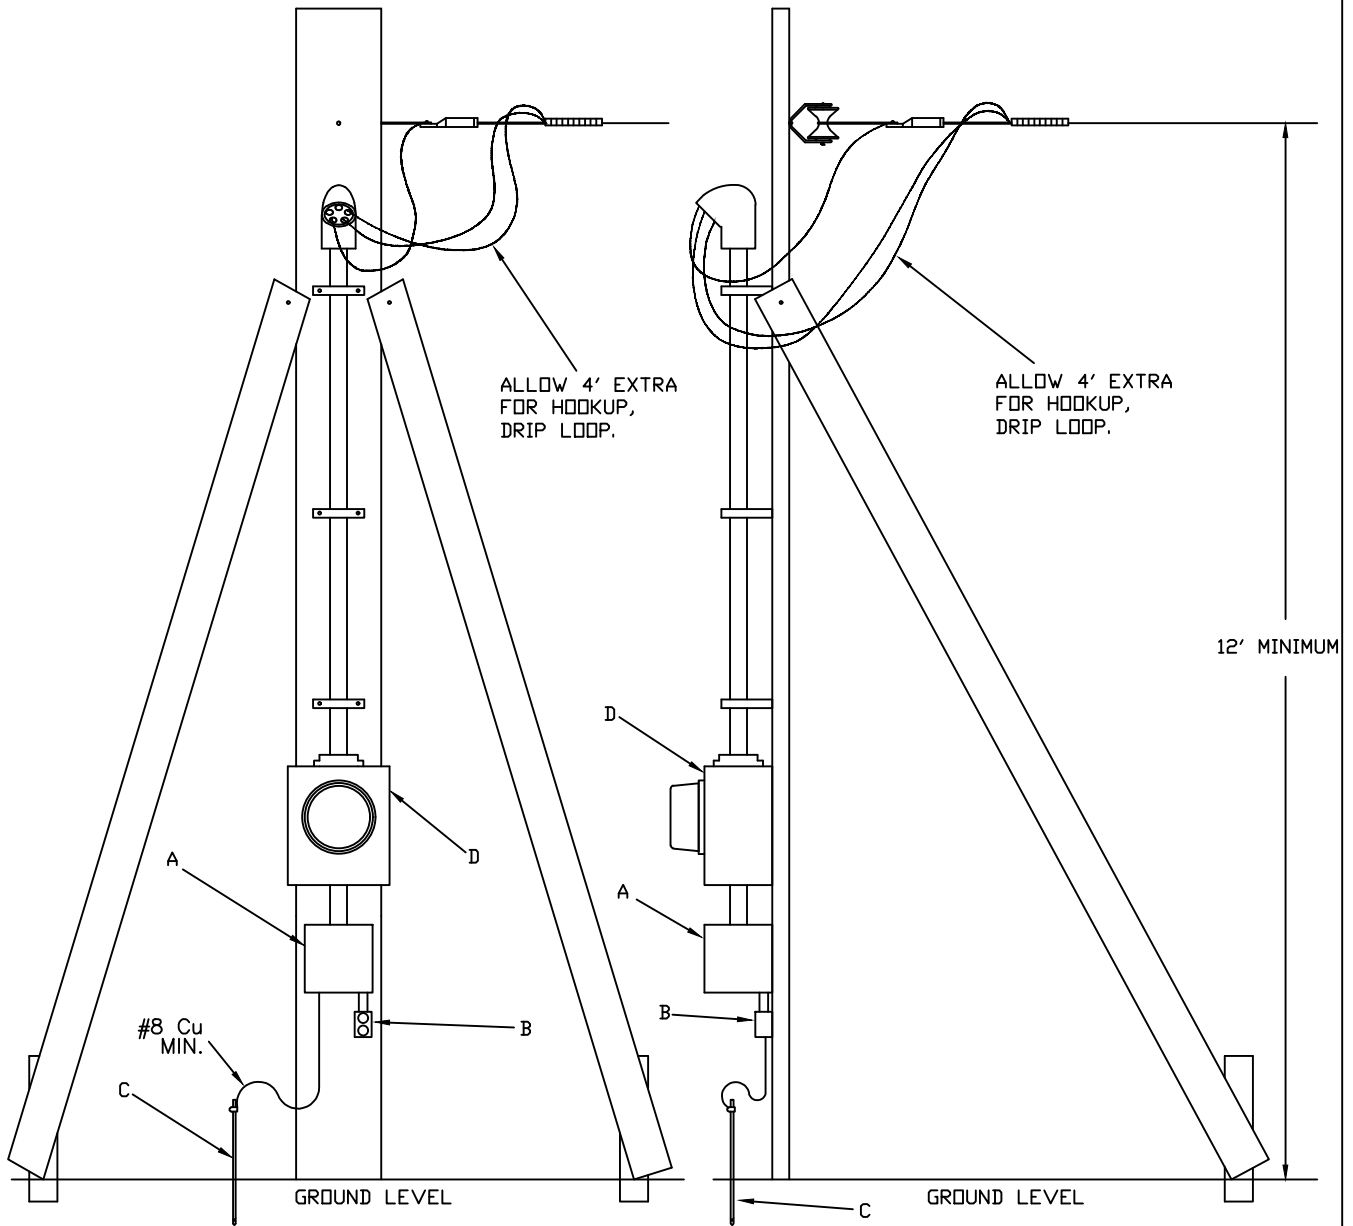

NOTES:

TEMPORARY SERVICE MUST PASS INSPECTION OF LOCAL GOVERNING AUTHORITY BEFORE METER IS SET.

SERVICE MUST BE WITHIN 15' OF D.E.C.C. SOURCE OF POWER.

ALL CIRCUITS ARE TO HAVE GFI PROTECTION.

ALL MATERIAL SUPPLIED AND ASSEMBLED BY MEMBER.

NO TEMPORARY LOOPS SHALL BE SET ON TREES OR D.E.C.C. POLES.

TEMPORARY LOOPS SHALL BE SET AWAY FROM ALL VEHICULAR TRAFFIC.

ITEM	MATERIAL	TYPICAL TEMPORARY SAW SERVICE OVERHEAD SOURCE	
A	RAIN TIGHT DISCONNECT ALL CIRCUITS SHALL HAVE GFI PROTECTION	OZARKS ELECTRIC COOPERATIVE CORP.	
B	ALL CONVENIENCE OUTLETS SHALL BE EXTERIOR TYPE, RAIN TIGHT, SOLIDLY FASTENED DOWN, WITH NO EXPOSED CONDUCTOR.	APPROVED BY: JDC	
C	GROUND ROD, WIRE, AND CONNECTORS TO BE INSTALLED BY MEMBER OR MEMBER'S ELECTRICIAN. BURY 7 FEET MINIMUM.	DRAWN BY: RJE 11-22-96	TEMP-A
D	METER SOCKET PROVIDED BY MEMBER	UPDATED BY: L4K 11-10-2023	